



ETA-Danmark A/S  
Göteborg Plads 1  
DK-2150 Nordhavn  
Tel. +45 72 24 59 00  
Fax +45 72 24 59 04  
Internet [www.etadanmark.dk](http://www.etadanmark.dk)

Authorized and notified according  
to Article 29 of the Regulation (EU)  
No 305/2011 of the European  
Parliament and of the Council of 9  
March 2011

MEMBER OF EOTA



## European Technical Assessment ETA-15/0719 of 02/12/2015

### General Part

#### Technical Assessment Body issuing the ETA and designated according to Article 29 of the Regulation (EU) No 305/2011: ETA-Danmark A/S

Trade name of the  
construction product:

Kerafix<sup>®</sup> Flexpan 200 NG-A  
Kerafix<sup>®</sup> Flexpan 200 NG-G and  
Kerafix<sup>®</sup> Flexpan 200 NG-SP

Product family to which the  
above construction product  
belongs:

Intumescent products for fire sealing and fire stopping  
purposes.

Manufacturer:

Rolf Kuhn GmbH  
Jägersgrund 10  
57339 Erndtebrück / Germany  
Tel. + 49 2753 5945-0  
Fax +49 2753 5945-52  
Internet [www.kuhn-brandschutz.com](http://www.kuhn-brandschutz.com)

Manufacturing plant:

Rolf Kuhn GmbH  
Jägersgrund 10  
57339 Erndtebrück / Germany

This European Technical  
Assessment contains:

6 pages including 1 annex which form an integral part of  
the document

This European Technical  
Assessment is issued in  
accordance with Regulation  
(EU) No 305/2011, on the  
basis of:

European Assessment Document (EAD) no. 350005-  
00-1104 "Intumescent products for fire sealing and fire  
stopping purposes"

This version replaces:

-

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (excepted the confidential Annex(es) referred to above). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

## II SPECIFIC PART OF THE EUROPEAN TECHNICAL ASSESSMENT

### 1 Technical description of product and intended use

#### Technical description of the product

Kerafix® Flexpan 200 NG-A, Kerafix® Flexpan 200 NG-G and Kerafix® Flexpan 200 NG-SP are intumescent materials which expand in case of fire.

The intumescent material Kerafix® Flexpan 200 NG-SP is a black strip and has a density range of  $1290 \text{ kg/m}^3 \pm 10 \%$ .

The intumescent material Kerafix® Flexpan 200 NG-A is a black strip and has a density range of  $1270 \text{ kg/m}^3 \pm 10 \%$ .

The intumescent material Kerafix® Flexpan 200 NG-G is a black strip and has a density range of  $1250 \text{ kg/m}^3 \pm 10 \%$ .

The intumescent product may be equipped on one side with a self-adhesive tape and on the other side with a lamination.

The Kerafix® Flexpan 200 NG-Series can be installed in fire classified doors made of steel, aluminium, wood and special areas of application, for example lock case insulation and door hinges, facades, safety cabinets or control cabinets. In dry construction: Inspection openings, partition walls and ceiling constructions gaps.

Detailed specifications for identification and performance criteria relevant for fire safety with regard to the construction products are given in Annex 1.

#### Specification of the intended use in accordance with the applicable European Assessment Document

The construction products The Kerafix® Flexpan NG 200-Series are intended for use as components with a fire protection effect in products made from Steel, Copper, Aluminium, PVC, PE.

Table 1 – components of the verified penetration seals

Product type	Trade name
Intumescent	Kerafix® Flexpan 200 NG-SP
	Kerafix® Flexpan 200 NG-A
	Kerafix® Flexpan 200 NG-G

Detailed information and data on the verified penetration seals are given in Annex 1.

The performances given in Section 3 exclusively relate to this penetration seals (e.g. with respect to the design and arrangement of the components of the penetration seals and the type and position of the services, see annex 2, 3 and 4).

The verification and assessment methods on which this European Technical Assessment is based, lead to the assumption of a working life for the Kerafix® Flexpan NG 200-Series of at least 10 years.

The indications given on the working life cannot be interpreted as a guarantee given by the manufacturer, but are to be regarded only as a means for choosing the right product in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

Characteristic	Assessment of characteristic
<b>3.2 Safety in case of fire (BWR 2)</b>	
Reaction to fire	<p>The Kerafix® Flexpan 200 NG-SP intumescent is classified as <b>Euroclass E</b> in accordance with EN 13501-1.</p> <p>The Kerafix® Flexpan 200 NG-A intumescent is classified as <b>Euroclass E</b> in accordance with EN 13501-1.</p> <p>The Kerafix® Flexpan 200 NG-G intumescent is classified as <b>Euroclass E</b> in accordance with EN 13501-1</p>
Resistance to fire	The performance “Resistance to fire” shall be demonstrated separately for the final use if requested
<b>3.3 Hygiene, health and the environment (BWR 3)</b>	
Influence on air quality	The product does not contain/release dangerous substances specified in TR 034, dated March 2012.
<b>3.7 Sustainable use of natural resources (BWR 7)</b>	No Performance Determined

\*) See additional information in section 3.9 – 3.12.

In addition to the specific clauses relating to dangerous substances contained in this European technical Assessment, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

#### 3.9 General aspects

The verification of durability is part of testing the essential characteristics. The intumescent construction product Kerafix® Flexpan 200 NG-A, Kerafix® Flexpan 200 NG-G and Kerafix® Flexpan 200 NG-SP may be used in end-use applications according to the provisions for category X without expecting significant changes of the characteristics relevant for fire sealing and fire stopping properties and the result performance.

The proof and its assessment concerning applicability under climate conditions were carried out in accordance with EOTA TR 024 clause 4.2.

## **4 Assessment and verification of constancy of performance (AVCP)**


### **4.1 AVCP system**

According to the decision 1999/454/EC of the European Commission, as amended by 2001/596/EC, the system(s) of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) is 1.

## **5 Technical details necessary for the implementation of the AVCP system, as foreseen in the applicable EAD**

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at ETA-Danmark.

Issued in Copenhagen on 2015-12-02 by

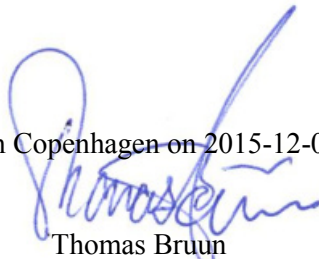

Thomas Bruun  
Managing Director, ETA-Danmark

**Annex 1**  
**Product details and definitions**

Product and performance of the **Kerafix® Flexpan 200 NG-SP**

Property	Method	Range
Thickness of strips	The determination has been carried out according to chapter 3.1.2 of EOTA TR No 024.	1.0 mm to 3.0 mm Tolerance: $\pm 10\%$
Expansion ratio	The determination has been carried out according to chapter 3.1.11 of EOTA TR No 024. Tested at 450 °C for 30 minutes.	Nominal thickness 1.0 mm to 3.0 mm 7 to 17
Expansion pressure	The determination has been carried out according to chapter 3.1.12 of EOTA TR No 024. Tested at 300 °C.	Nominal thickness 1.0 mm to 3.0 mm No significant value

Product and performance of the **Kerafix® Flexpan 200 NG-A**

Property	Method	Range
Thickness of strips	The determination has been carried out according to chapter 3.1.2 of EOTA TR No 024.	1.0 mm to 3.0 mm Tolerance: $\pm 10\%$
Expansion ratio	The determination has been carried out according to chapter 3.1.11 of EOTA TR No 024. Tested at 450 °C for 30 minutes.	Nominal thickness 1.0 mm 22 to 37  Nominal thickness 3.0 mm 18 to 33
Expansion pressure	The determination has been carried out according to chapter 3.1.12 of EOTA TR No 024. Tested at 300 °C.	Nominal thickness 1.0 mm 0.6 – 1.3 N/mm <sup>2</sup>  Nominal thickness 3.0 mm 0.4 – 1.0 N/mm <sup>2</sup>

Product and performance of the **Kerafix® Flexpan 200 NG-G**

Property	Method	Range
Thickness of strips	The determination has been carried out according to chapter 3.1.2 of EOTA TR No 024.	1.0 mm to 3.0 mm Tolerance: $\pm 10\%$
Expansion ratio	The determination has been carried out according to chapter 3.1.11 of EOTA TR No 024. Tested at 450 °C for 30 minutes.	Nominal thickness 1.0 mm 15 to 27  Nominal thickness 3.0 mm 13 to 25
Expansion pressure	The determination has been carried out according to chapter 3.1.12 of EOTA TR No 024. Tested at 300 °C.	Nominal thickness 1.0 mm 0.5 – 1.0 N/mm <sup>2</sup>  Nominal thickness 3.0 mm 0.3 – 0.8 N/mm <sup>2</sup>